

USER'S MANUAL

TARG Series - Single Package Electric Cooling Unit

TPRG Series - Single Package Electric Heat Pump Unit

TGRG Series - Single Package Gas Heating / Electric Cooling Unit



TGRG Series

TARG / TPRG Series



⚠ WARNING:

FIRE OR EXPLOSION HAZARD

- Failure to follow safety warnings exactly could result in serious injury or property damage.
- Installation and service must be performed by a qualified installer, service agency or the gas supplier.
- Do not store or use gasoline or other flammable vapors and liquids in the vicinity of this or any other appliance.

WHAT TO DO IF YOU SMELL GAS

- Do not try to light any appliance.
- Do not touch any electrical switch; do not use any phone in your building.
- Leave the building immediately.
- Immediately call your gas supplier from a neighbor's phone. Follow the gas supplier's instructions.
- If you cannot reach your gas supplier, call the fire department.

⚠ AVERTISSEMENT

RISQUE D'INCENDIE OU D'EXPLOSION

- Le non-respect des avertissements de sécurité pourrait entraîner des blessures graves, la mort ou des dommages matériels.
- L'installation et l'entretien doivent être effectués par un installateur qualifié, un organisme de service ou le fournisseur de gazstaller, service agency or the gas supplier.
- Ne pas entreposer ni utiliser de l'essence ni d'autres vapeurs ou liquides inflammables dans le voisinage de cet appareil, ni de tout autre appareil.

QUE FAIRE S'IL Y A UNE ODEUR DE GAZ

- Ne pas tenter d'allumer aucun appareil.
- Ne toucher à aucun interrupteur électrique; n'utiliser aucun téléphone dans le bâtiment.
- Évacuer l'immeuble immédiatement.
- Appeler immédiatement le fournisseur de gaz en employant le téléphone d'un voisin. Respecter à la lettre les instructions du fournisseur de gaz.
- Si personne ne répond, appeler le service des incendies.

IMPORTANT SAFETY INFORMATION

Please read all information in this manual thoroughly and become familiar with the capabilities and use of your appliance before attempting to operate or maintain this unit. Pay attention to all safety warnings and any other special notes highlighted in the manual.

Safety markings are used frequently throughout this manual to designate a degree or level of seriousness and should not be ignored. **WARNING** indicates a potentially hazardous situation that if not avoided, could result in personal injury or death. **CAUTION** indicates a potentially hazardous situation that if not avoided, may result in minor or moderate injury or property damage.

WARNING:

To avoid possible equipment damage, fire, or personal injury, the following instructions must be observed regarding unit maintenance and operational procedures.

WARNING:

This single package electric cooling / heat pump contains liquid and gaseous refrigerant under pressure. Installation and servicing should only be attempted by qualified, trained personnel thoroughly familiar with the equipment and safe responsible refrigerant handling procedures. Failure to comply with this warning could result in equipment damage, personal injury, or death.

- Under no circumstances should the appliance owner attempt to install and/or service this equipment. Some local codes require licensed installation / service personnel for this type of equipment. Improper service, adjustment, or maintenance may cause explosion, fire, electrical shock or other hazardous conditions which may result in personal injury or property damage.
- Keep this literature where you have easy access to it in the future. If a problem occurs, check the instructions and follow recommendations given. If these suggestions don't eliminate your problem, call your servicing contractor. Do not attempt to service this unit yourself!
- To achieve optimum performance and minimize equipment failure, it is recommended that periodic maintenance be performed on this unit. The ability to properly perform maintenance on this equipment requires certain mechanical skills and tools. Please consult your dealer for maintenance information and availability of maintenance contracts.
- Do not block or obstruct air openings on the unit or air openings supplying the area where it is installed.
- Do not use this unit if any part has been under water. A flood-damaged unit is extremely dangerous. Attempts to use the unit can result in fire or explosion. A qualified service agency should be contacted to inspect the unit and to replace all gas controls, control system parts, electrical parts that have been wet or the furnace if deemed necessary.

TGRG Gas / Electric Models

- The area around the gas heating / electric cooling unit and the vicinity of any other gas appliances must be kept clear and free of combustible materials, gasoline, and other flammable vapors and liquids. Do not store or use flammable items such as paint, varnish, or strippers in the vicinity of the unit.
- For areas around the units gas heating section, precautions should be taken to prevent blockage of the flue exhaust and combustion air louvers from large amounts accumulating snow.
- Do not use the area around the unit as a storage area. This area must be kept clean and clear of loose or exposed insulation materials. Examine the unit's area when it is installed or when insulation is added, since some insulation materials may be combustible.
- Familiarize yourself with the controls that shut off the gas and electrical power to the unit. If the unit is to be shut down for an extended period of time, turn off both the gas and electrical power. For your safety always turn off both the gas and electrical power before performing service or maintenance on the furnace. If the gas supply to the unit must be shut off, refer to the gas valve label (Figure 2, page 5).

Combustion Air Supply

WARNING:

Combustion air must not be drawn from a corrosive atmosphere.

The gas heating/electric cooling unit needs an adequate supply of combustion and ventilation air for proper and safe operation. Do not block or obstruct air openings on the unit or air openings supplying the area where it is installed.

If the unit is operated with inadequate combustion air supply, the flame roll-out control switch located above the burners will open, turning off the gas supply to the burners. The flame roll-out control is a manual reset device. Do not attempt to reset this device yourself! Call your servicing contractor.

To maximize heat exchanger life, the combustion air must be free of chemicals which form corrosive acidic compounds in the combustion gases. **IMPORTANT NOTE:** Do not store any chemicals with flammable or caustic vapors near the vent termination. Some examples of these chemicals are:

- Gasoline/Kerosene
- Permanent wave solutions
- Chlorinated waxes and cleaners
- Chlorine based swimming pool chemicals
- Water softening chemicals
- De-icing salts or chemicals
- Carbon tetrachloride
- Halogen type refrigerants
- Cleaning solvents
- Cements, glues, paint removers, varnishes, etc.
- Hydrochloric acid
- Masonry acid washing materials

Ductwork

WARNING:

Failure to prevent products of combustion from being circulated into the occupied space can create potentially hazardous conditions including carbon monoxide poisoning that could result in personal injury or death.

The duct connections must be physically sound and sealed to the unit's casing to prevent products of combustion from entering the occupied space.

The return air and circulating air ductwork must not be connected to any other heat producing device such as a fireplace insert, stove, etc. Doing so may result in fire, explosion, personal injury, carbon monoxide poisoning, or property damage.

SYSTEM MAINTENANCE

CAUTION:

Verify all electrical power to the unit is disconnected and the gas is shut off before performing the following recommended maintenance.

These single package appliances have been tested for capacity and efficiency in accordance with AHRI Standards and will provide many years of safe and dependable comfort, providing they are properly installed and maintained. With regular maintenance, your unit will operate satisfactorily year after year.

Proper maintenance is most important to achieve the best performance from the appliance and should be performed by a qualified service technician at least once a year. Follow the maintenance schedule and the instructions below for years of safe, trouble free operation.

- Annually inspect the physical support of the unit to ensure that it is physically sound without sagging, cracks, gaps, etc., around the base so as to provide a seal between the support and the base.
- Annually inspect the return-air connection to ensure that it is physically sound and is still sealed to the casing of the unit. Also inspect the unit, ductwork, and vent system for signs of physical deterioration.
- Do not operate the unit without all doors and covers in place. Avoid operating the unit when windows and doors are open.
- Refer to the Maintenance Schedule in Table 1 for recommended maintenance information.

Regular Cleaning

CAUTION:

DO NOT make contact with any of the internal electrical components while cleaning the unit.

- Remove any leaves and grass clippings from the outdoor coil. Check for and remove any obstructions such as twigs, sticks, etc. **Be careful not to damage the aluminum fins**

Air Filters

WARNING:

Never operate the unit without a filter in the return air system. Dust and lint in the return air can build up on the internal components, resulting in loss of efficiency, equipment damage, and possible fire risk.

This unit is not supplied with air filter(s) and has no means for accommodating internal air filter(s). The installer is responsible for installing a filtration system into the return air duct of this system. The filter(s) of this system should be checked monthly.

It is very important to replace or clean the filter(s) installed in the return air duct of this system. A clogged filter could cause airflow related problems and reduce the overall efficiency of your unit. Depending upon which type of filter was installed with your unit, clean (permanent) or replace (disposable) filter(s) of your system at the beginning of every heating season, the beginning of every cooling season, and when an accumulation of dust and dirt are visible on the filter.

IMPORTANT: Replace disposable filter(s) installed in your system only with the same size dimensional filters that are being replaced. Clean permanent filter(s) as described by the manufacturer.

TROUBLESHOOTING

Before you call a Technician, check the following:

- Check the thermostat setting. Make sure the system mode and temperature settings are correct.
- Check the electrical panel for tripped circuit breakers.
- Check the filters for dust accumulation.
- Check the unit and make sure it is clean and not covered with grass or leaves.
- If the items above don't resolve your problems, then call your nearest service technician.

MAINTENANCE ITEM	FREQUENCY OF MAINTENANCE		
	BEGINNING OF HEATING SEASON	END OF HEATING SEASON	MONTHLY
Verify area around the unit is free of combustible materials	X		X
Verify combustion and ventilation air is not restricted	X	X	X
Verify no signs of physical deterioration of the furnace	X	X	X
Inspect unit support	X	X	
Inspect return air connections	X	X	
Clean or replace filter(s)			X

Table 1. Maintenance Schedule

GAS HEATING / ELECTRIC COOLING UNITS

ABOUT THE GAS HEATING / ELECTRIC COOLING UNIT

This gas heating unit with electric cooling has been designed and built to provide many years of safe and dependable comfort, providing it is properly installed and maintained. With regular maintenance, this unit will operate satisfactorily year after year. Abuse, improper use, and/or improper maintenance can shorten the life of the appliance and create unsafe hazards. A regular service and maintenance schedule should be established to ensure efficient and safe operation of the unit. See System Maintenance on page 5.

This unit uses environmentally friendly R-410A refrigerant.

OPERATING INSTRUCTIONS

Thermostat styles vary. Some models may not include an AUTO heat/cool changeover mode and others will have the AUTO heat/cool changeover in addition to HEAT & COOL. Please refer to the thermostat's User manual for detailed programming instructions.

The thermostat should be mounted about 5 feet above the floor on an inside wall and not on an outside wall or other location where its operation may be adversely affected by radiant heat from fireplaces, sunlight, or lighting fixtures, and convective heat from warm air registers or electrical appliances.

Cooling Operation

1. Set the thermostat system mode to COOL and the thermostat fan mode to AUTO. See Figure 1.
2. Set the thermostat temperature selector to the desired temperature level. The outdoor fan, compressor, and indoor blower will all cycle on and off to maintain the indoor temperature at the desired cooling level.

NOTE: If the temperature level is re-adjusted, or the system mode is reset, the fan and compressor in the outdoor unit may not start immediately. There may be a protective timer circuit in the thermostat which holds the compressor and the outdoor fan off for approximately 5 minutes following a previous operation or the interruption of the main electrical power.

Heating Operation

1. Set the thermostat system mode to Heat and the thermostat fan mode to AUTO. See Figure 1.
2. Set the thermostat temperature selector to the desired temperature level. The indoor blower and gas heat module will cycle on and off to maintain the indoor temperature at the desired heating level.

WARNING:

If overheating occurs, or the gas supply fails to shut off, shut off the gas valve to the unit before shutting off the electrical supply.

System Shutdown

Set the thermostat system mode to OFF (see Figure 1) and the thermostat fan mode to AUTO. **NOTE:** The system will not operate, regardless of the thermostat temperature selector's setting.

Continuous Indoor Blower Operation

The continuous indoor blower operation is typically used to circulate the indoor air to equalize a temperature imbalance due to a solar load, cooking, or fireplace operation.

Set the thermostat fan mode to ON (see Figure 1). The indoor blower will start immediately and will run continually until the fan switch is reset to AUTO. **NOTE:** On some thermostat models the setting may be called CONT.

The continuous indoor blower operation can be obtained with the thermostat system switch set in any position, including OFF.

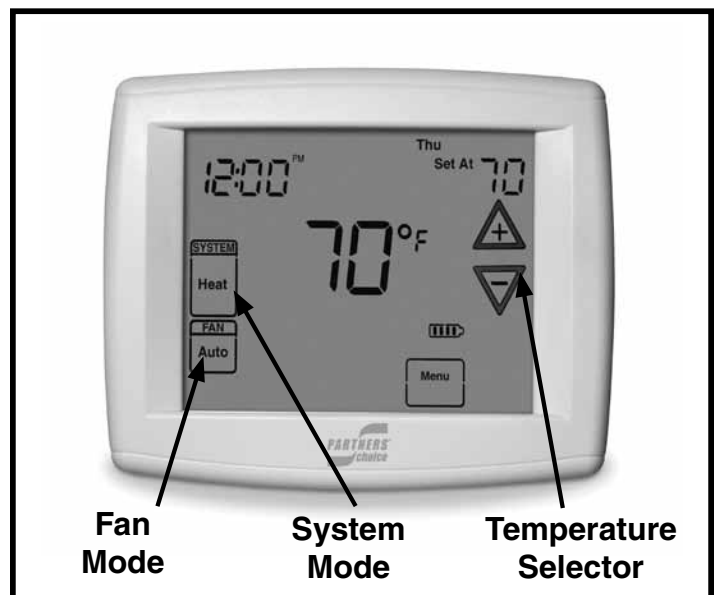


Figure 1. Digital Thermostat

GAS HEATING / ELECTRIC COOLING UNITS

FOR YOUR SAFETY READ BEFORE OPERATING

WARNING: If you do not follow these instructions exactly, a fire or explosion may result causing property damage, personal injury, or loss of life.

- A. This appliance does not have a pilot. It is equipped with an ignition device which automatically lights the burner. Do not try to light the burner by hand.
- B. BEFORE OPERATING smell all around the appliance area for gas. Be sure to smell next to the floor because some gas is heavier than air and will settle on the floor.
- WHAT TO DO IF YOU SMELL GAS**
- Do not try to light any appliance.
 - Do not touch any electrical switch; do not use any phone in your building.
 - Immediately call your gas supplier from a neighbor's phone. Follow the gas supplier's instructions.
 - If you cannot reach your gas supplier, call the fire department.
- C. Use only your hand to push in or turn the gas control knob. Never use tools. If the knob will not push in or move by hand, do not try to repair it, call a qualified service technician. Force or attempted repair may result in a fire or explosion.
- D. Do not use this appliance if any part has been under water. Immediately call a qualified service technician to inspect the appliance and to replace any part of the control system and any gas control which has been under water.

POUR VOTRE SÉCURITÉ. À LIRE AVANT L'EMPLOI

ATTENTION! L'observation de ces instructions peut entraîner un incendie ou une explosion pouvant causer des dommages à votre propriété à votre personne, ou la mort.

- A. Cet appareil ménager n'a pas de veilleuse. Il est doté d'un système d'allumage automatique. Ne pas essayer d'allumer le brûleur manuellement.
- B. AVANT L'USAGE. Attention à une possible odeur de gaz surtout au niveau du plancher où les gaz les plus lourds ont la tendance de se concentrer.
- EN CAS D'ODEUR DE GAZ.**
- Ne mettre en marche aucun appareil électrique.
 - Ne toucher à aucun commutateur électrique, ne pas employer le téléphone.
 - Quitter le bâtiment immédiatement et avvertir la compagnie du gaz en utilisant le téléphone d'un voisin.
 - A défaut de la compagnie du gaz, avvertir le service des pompiers.
- C. Enfoncer ou faire tourner le robinet à gaz à la main seulement. Ne jamais utiliser d'outils. S'il n'est pas possible de faire tourner ou d'enfoncer le robinet à la main, ne pas essayer de le réparer. Faire appel à un spécialiste. Forcer ou tenter de réparer le robinet pourrait être à l'origine d'une explosion ou d'un incendie.
- D. Il est déconseillé d'utiliser cet appareil en contact prolongé avec l'eau. Faire inspecter ou remplacer toute commande par un technicien qualifié si un des systèmes de contrôle du gaz s'est trouvé sous l'eau.

OPERATING INSTRUCTIONS

1. **STOP!** Read the safety information above on this label.
2. Set the thermostat to the lowest setting.
3. Turn off all electrical power to the appliance.
4. The appliance's ignition device automatically lights the burner. Do not try to light burner by hand.
5. Remove the control access door/panel (upper door if two-door model).
6. Move the gas control switch to the "OFF" position. (See Figure 1)
7. Wait five (5) minutes to clear out any gas. Then smell for gas, including near the floor. If you smell gas, STOP! Follow "B" in above information. If you don't smell gas, go to the next step.
8. Move the gas control switch to the "ON" position. (See Figure 1)
9. Replace the control access door/panel (upper door if two-door model).
10. Turn on all electrical power to the appliance.
11. Turn the thermostat to a desired setting.
12. If the appliance will not operate, follow the instructions "To Turn Off Gas To Appliance" and call your service technician or gas supplier.




Figure 1

MODE D'EMPLOI

1. **ATTENTION!** Lire d'abord la liste des mesures de sécurité ci-dessus.
2. Mettre le thermostat à la position minimale.
3. Couper le courant électrique qui mène à l'appareil.
4. Cet appareil ménager étant doté d'un système d'allumage automatique, ne pas essayer d'allumer le brûleur manuellement.
5. Retirer le panneau/volet d'accès de commande (panneau supérieur s'il s'agit d'un modèle à deux panneaux).
6. Régler l'interrupteur de commande du gaz à la position "OFF". (voir Figure 1).
7. Attendre cinq (5) minutes pour s'assurer de la dissipation du gaz. En cas d'odeur, ARRÊTER LE PROCÉDÉ. Suivre les instructions ci-dessus (Section B). En l'absence de toute odeur de gaz, avancer à l'étape suivante.
8. Régler l'interrupteur de commande du gaz à la position "ON". (voir Figure 1).
9. Remettre le panneau/volet d'accès de commande en place (panneau supérieur s'il s'agit d'un modèle à deux panneaux).
10. Rebrancher l'appareil sur le réseau électrique.
11. Ajuster le thermostat à la position désirée.
12. Si l'appareil ne fonctionne pas, suivre les "Directives d'arrêt" cidessous et appeler le technicien de service.

TO TURN OFF GAS TO APPLIANCE

1. Set the thermostat to the lowest setting.
2. Turn off all electrical power to the appliance if service is to be performed.
3. Remove the control access door/panel (upper door if two-door model).
4. Move the gas control switch to the "OFF" position. Do not use force. (See Figure 1)
5. Replace the control access door/panel (upper door if two-door model).



Figure 2. Gas Valve Label

DIRECTIVES D'ARRÊT

1. Mettre le thermostat à la position minimale.
2. Débrancher l'appareil en prévision de la réparation.
3. Retirer le panneau/volet d'accès de commande (panneau supérieur s'il s'agit d'un modèle à deux panneaux).
4. Régler l'interrupteur de commande du gaz à la position "OFF". Ne forcez pas. (voir Figure 1).
5. Remettre le panneau/volet d'accès de commande en place (panneau supérieur s'il s'agit d'un modèle à deux panneaux).

7111710 (04/11)

COOLING ONLY UNITS

ABOUT THE COOLING UNIT

The single packaged electric cooling unit is a high efficient self contained appliance that will cool your home and provide energy saving comfort. Additional features and benefits of the cooling include:

- Indoor and outdoor coils are designed to optimize heat transfer, minimize size and cost, and increase durability and reliability.
- Environmentally friendly R-410A Refrigerant.

OPERATING INSTRUCTIONS

Thermostat styles vary. Some models may not include an AUTO heat/cool changeover mode and others will have the AUTO heat/cool changeover in addition to HEAT & COOL. Please refer to the thermostat's User manual for detailed programming instructions.

The thermostat should be mounted about 5 feet above the floor on an inside wall and not on an outside wall or other location where its operation may be adversely affected by radiant heat from fireplaces, sunlight, or lighting fixtures, and convective heat from warm air registers or electrical appliances.

Cooling Operation

1. Set the thermostat system mode to COOL and the thermostat fan mode to AUTO. See Figure 1.
2. Set the thermostat temperature selector to the desired temperature level. The outdoor fan, compressor, and indoor blower will all cycle on and off to maintain the indoor temperature at the desired cooling level.

NOTE: If the temperature level is re-adjusted, or the system mode is reset, the fan and compressor in the outdoor unit may not start immediately. There may be a protective timer circuit in the thermostat which holds the compressor and the outdoor fan off for approximately 5 minutes following a previous operation or the interruption of the main electrical power.

Heating Operation - Optional Electric Heat

1. Set the thermostat system mode to Heat and the thermostat fan mode to AUTO. See Figure 1.
2. Set the thermostat temperature selector to the desired temperature level. The indoor blower and electric heat module will cycle on and off to maintain the indoor temperature at the desired heating level.

System Shutdown

Set the thermostat system mode to OFF and the thermostat fan mode to AUTO. See Figure 1. **NOTE:** The system will not operate, regardless of the thermostat temperature selector's setting.

Operating the Indoor Blower Continuously

Set the thermostat fan mode to ON (or CONT on some thermostat models). See Figure 1.

The indoor blower will start immediately, and will run continually until the fan mode is reset to AUTO.

The continuous indoor blower operation can be obtained with the thermostat system mode set in any position, including OFF.

The continuous indoor blower operation is typically used to circulate the indoor air to equalize a temperature imbalance due to a solar load, cooking, or fireplace operation.

HEAT PUMP UNITS

ABOUT THE HEAT PUMP

Your heat pump is a unique, all weather comfort-control appliance that will heat and cool your building year round and provide energy saving comfort. It's an unknown fact that heat is always in the air, even when the outside temperature is below freezing. The heat pump uses basic laws of physics to provide energy saving heat during the winter months.

In colder temperatures, the heat pump performs like an air conditioner run in reverse. Available heat energy outside the building is absorbed by the refrigerant and exhausted inside. This efficient process means you only pay for "moving" the heat from the outdoors to the indoor area. You do not pay to generate the heat, as is the case with more traditional furnace designs.

During summer, the heat pump reverses the flow of the heat-absorbing refrigerant to become an energy-efficient, central air conditioner. Excess heat energy inside the home is absorbed by the refrigerant and exhausted outside the building.

This unit uses environmentally friendly R-410A refrigerant.

OPERATING INSTRUCTIONS

Thermostat styles vary. Some models may not include an AUTO heat/cool changeover mode and others will have the AUTO heat/cool changeover in addition to HEAT & COOL. Please refer to the thermostat's User manual for detailed programming instructions.

The thermostat should be mounted about 5 feet above the floor on an inside wall and not on an outside wall or other location where its operation may be adversely affected by radiant heat from fireplaces, sunlight, or lighting fixtures, and convective heat from warm air registers or electrical appliances.

NOTE: If the temperature level is re-adjusted, or the system mode is reset, the fan and compressor in the outdoor unit may not start immediately. A protective timer circuit holds the compressor and the outdoor fan off for approximately 5 minutes following a previous operation or the interruption of the main electrical power.

Cooling Operation

1. Set the thermostat system mode to COOL and the thermostat fan mode to AUTO. See Figure 1.
2. Set the thermostat temperature selector to the desired temperature level. The outdoor fan, compressor, and indoor blower will all cycle on and off to maintain the indoor temperature at the desired cooling level.

Heating Operation - Heat Pump Mode

1. Set the thermostat's system mode to HEAT or AUTO and change the fan mode to AUTO. See Figure 1 (pg 3).
2. Set the temperature selector to the desired temperature level. The compressor, outdoor fan, and blower motor will cycle on and off to maintain the indoor temperature at the desired heating level.

NOTE: On some thermostats, if the heating load on the conditioned space is not met in a normal period of time or the difference between the thermostat set point and room temperature is large, the heat pump will automatically shut off and the electric heat will operate until the thermostat demand for heat is met.

Emergency Heat - Electric Heat mode

Heat pump thermostats include a system mode called EM HT or AUX HT, etc. This is a back-up heating mode that should only be used if a problem is suspected. With the mode set to EM HT, etc., the compressor and outdoor fan will be locked off and electric heat will be used as a source of heat. Sustained use of electric heat in place of the heat pump will result in an increase in this utility cost. Refer to the thermostat manual for more info.

Defrost Operation

During cold weather heating operation, the outdoor unit will develop a coating of snow and ice on the heat transfer coil. This is normal and the unit will defrost itself. This unit will monitor ambient and coil temperatures to regulate the defrost function accordingly.

At the beginning of the defrost cycle, both the outdoor condenser fan and compressor will turn off. After approximately 30 seconds, the compressor will turn on and begin to heat the outdoor coil causing the ice and snow to melt.

During the defrost period, the electric heat will energize and produce warm air to offset the heat pump operation while in its reverse cycle. Initially the air out of the supply registers may be slightly cooler since the heat pump has reversed its cycle and is now in the cooling mode to aide in the defrosting of the outdoor coil. The air will rise in temperature as the electric heat continues to operate.

NOTE: While the ice and snow is melting, some steam may rise from the outdoor unit as the warm coil causes the melting frost to evaporate. When defrost is completed, the outdoor fan motor will start, and the compressor will turn off again. In approximately 30 seconds the compressor will start up again and continue normal operation. The electric heat will shut down at the end of the defrost cycle.

Automatic Cooling & Heating Operation

1. Set the thermostat system mode to AUTO and the thermostat fan mode to AUTO. See Figure 1 (page 3).
2. Set the thermostat's temperature selector to the desired heating and cooling temperature level(s). The outdoor unit and the indoor blower will then cycle on and off in either the heating or cooling mode of operation as required to automatically maintain the indoor temperature within the desired limits.

Operating the Indoor Blower Continuously

The continuous indoor blower operation is typically used to circulate the indoor air to equalize a temperature imbalance due to a solar load, cooking, or fireplace operation. Set the thermostat fan mode (Figure 1) to ON (or CONT on some thermostat models). The indoor blower will start immediately, and will run continually until the fan mode is reset to AUTO. The continuous indoor blower operation can be obtained with the thermostat system mode set in any position, including OFF.

System Shutdown

Set the thermostat system mode (Figure 1) to OFF and the thermostat fan mode to AUTO. **NOTE:** The system will not operate, regardless of the thermostat temperature selector's setting.

WARRANTY INFORMATION

A warranty certificate with full details is included with the equipment. Carefully review these responsibilities with your dealer or service company. The manufacturer will not be responsible for any costs found necessary to correct problems due to improper setup, improper installation, adjustments, improper operating procedure on the part of the user. Some specific examples of service calls which are not included in the limited warranty are:

- Correcting wiring problems in the electrical circuit supplying the equipment.
- Resetting circuit breakers or other switches.
- Adjusting or calibrating of thermostat.



HRAI
YOUR ENVIRONMENT • OUR EXPERTISE
✓ MEMBER COMPANY



HEAT CONTROLLER

1900 Wellworth Ave., Jackson MI 49203 • Ph. 517-787-2100 • www.heatcontroller.com

A **WELLS** Company

Specifications & illustrations subject to change without notice or incurring obligations (01/15).




10067710 (Replaces 7095190)